
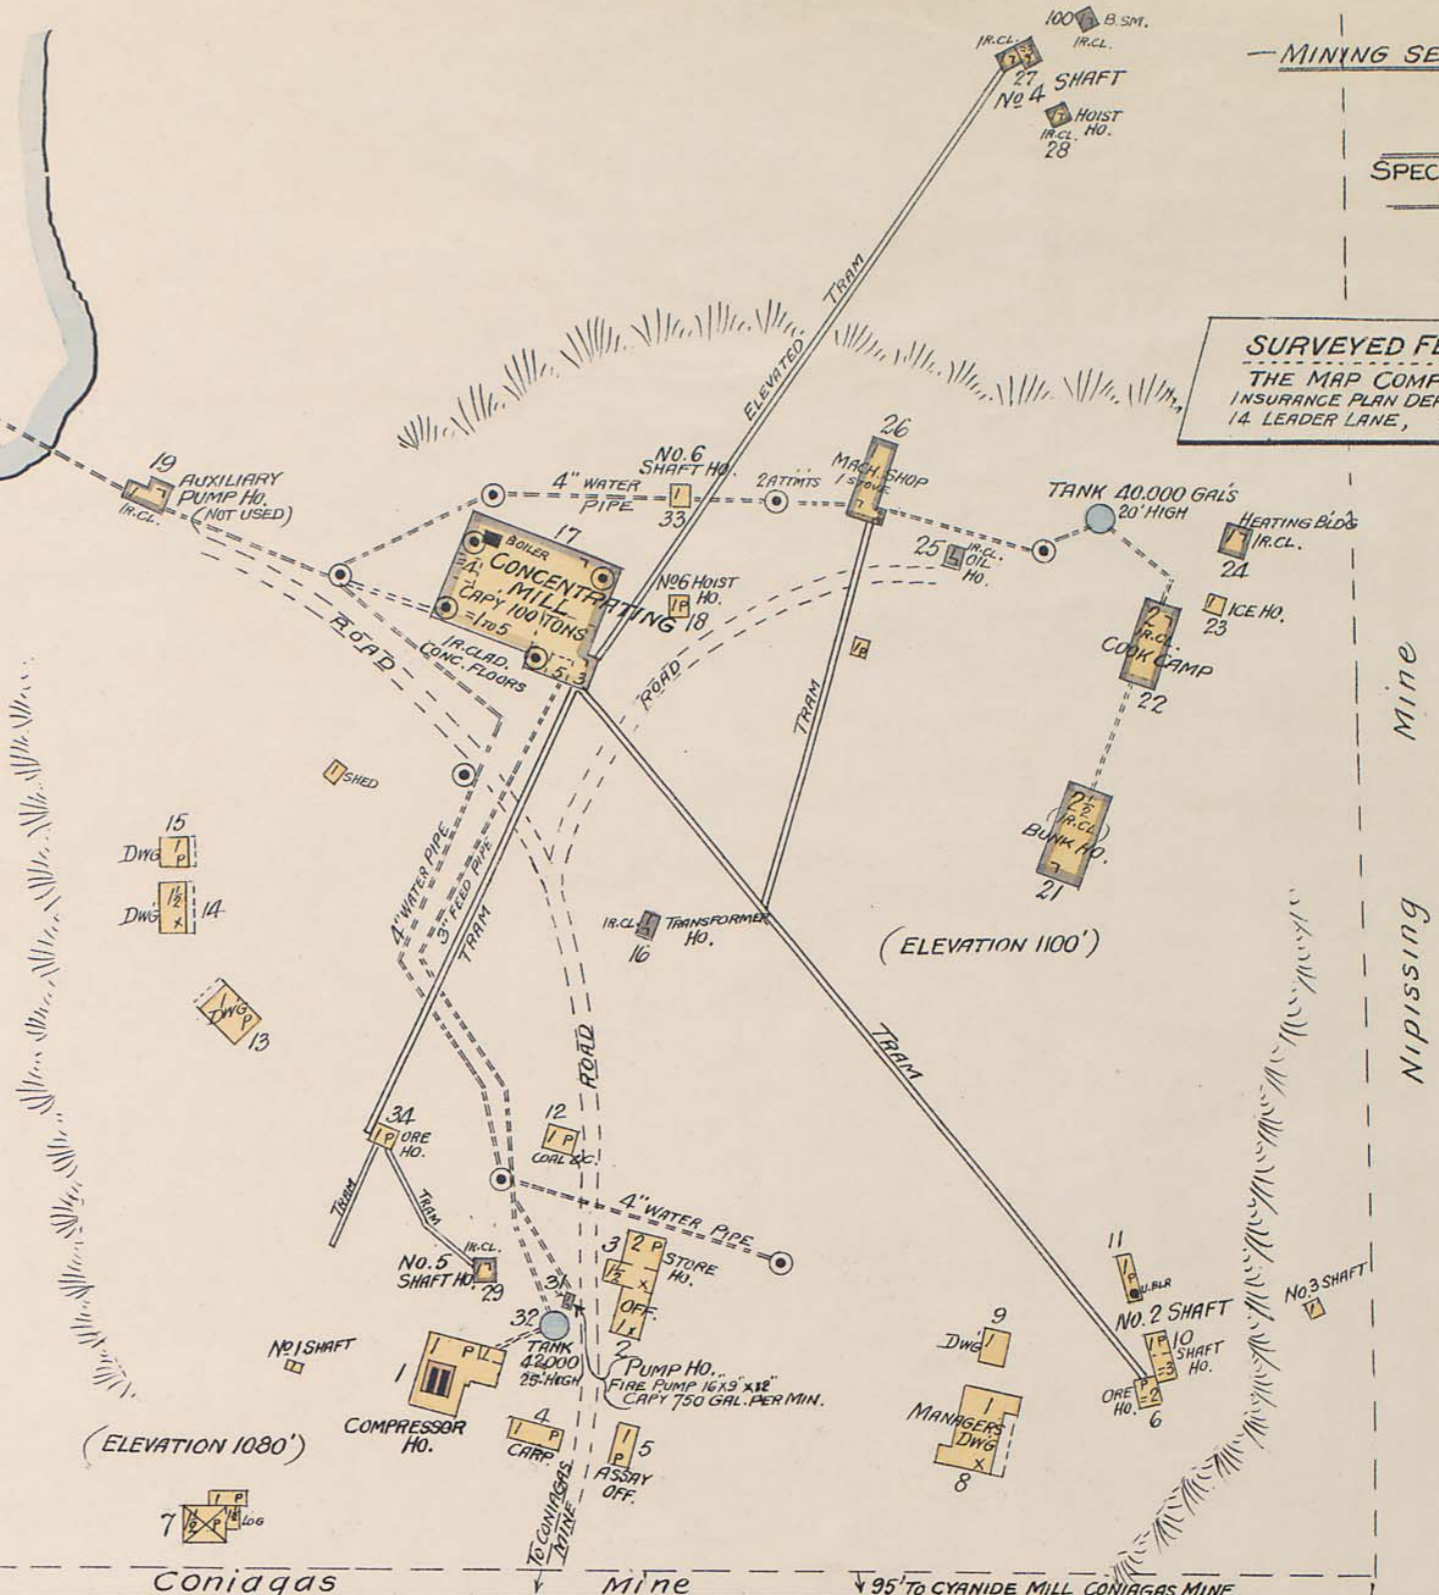
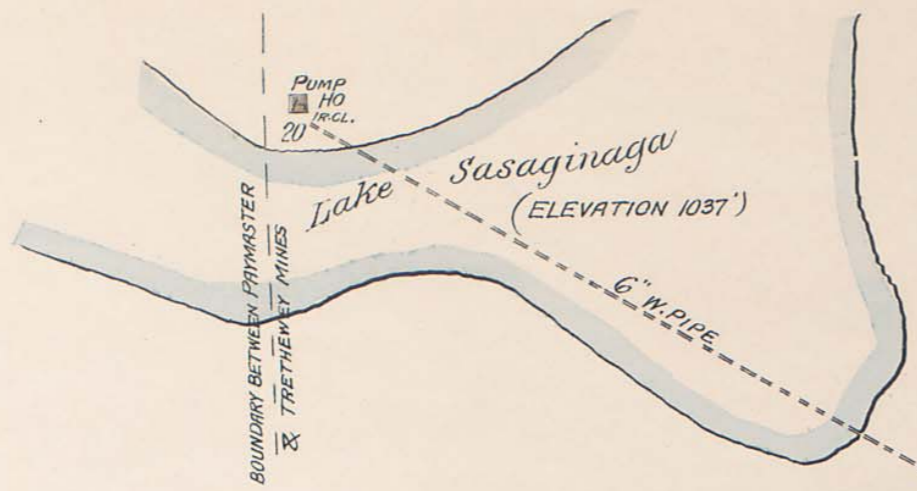


SURVEYED FEB. 1916  
THE MAP COMPANY  
INSURANCE PLAN DEPARTMENT  
14 LEADER LANE, TORONTO, ONT.

# Trethewey Silver-Cobalt Mine-Limited COBALT ONT.

HEAT-STEAM, POWER-ELECTRIC, LIGHT-ELECTRIC.  
STAND PIPES & HOSE CONNECTIONS AS SHOWN. CHEMICAL EXT'RS DISTRIBUTED.  
WATER SUPPLY SASAGINAGA LAKE. 6" MAIN FROM PUMP AT LAKE.  
2 WATER TANKS, 40,000 & 42,000 GALS CAPACITY. FAIRBANKS-MORSE UNDERWRITERS FIRE  
PUMP 16"x9"x12" CAPACITY 750 GALS PER MINUTE.  
750' 2 1/2" HOSE. NIGHT WATCHMAN & CLOCK 7 STATIONS  
NO HOSE CONNECTED TO STAND PIPES.

N.B. PLANT NOT RUNNING AT TIME OF SURVEY (FEB. 1916)  
FIRE PROTECTION, STAND PIPES & C. NOT IN OPERATION.  
NEAREST PROTECTION, CONIAGAS MINES LTD & TOWN FIRE DEPT.  
WATCHMAN MAKES ROUNDS.



Sasaginaga (Elevation 1037')

101 PUMP HO. ELECTRIC PUMP

PAYMASTER MINE

35' TO BUNK HO. CONIAGAS MINE

Coniagas

Mine

95' TO CYANIDE MILL CONIAGAS MINE

Mine

Nipissing